

THE PORT AUTHORITY  
OF NY & NJ



ORIGINAL SIGNED & SEALED BY  
N.Y. P.E. (OR R.A.)

**Joseph R. Loring  
& Associates, Inc.**  
consulting engineers

One Pennsylvania Plaza  
New York, New York 10029-0045  
Tel: (212) 543-7400, Fax: (212) 543-7362

THE OFFICE OF  
**DAVID  
ELIOT  
LESCOWITZ**  
P.E.  
REGISTERED PROFESSIONAL ENGINEER  
IN THE STATE OF NEW YORK  
No. 12345, Exp. 12/31/99

**LESLIE E. ROBERTSON**  
ASSOCIATES, P.L.L.C.  
CONSULTING STRUCTURAL ENGINEERS  
20 EAST 40TH STREET  
NEW YORK, NY 10018-3608  
TEL: (212) 697-8800 FAX: (212) 697-8801

I HEREBY CERTIFY THAT THIS IS A TRUE AND CORRECT  
COPY OF ONE OF THE CONTRACT DRAWINGS CON-  
STITUTING A PART OF CONTRACT NO. **WTC-945-071**  
IN THE FORM IN WHICH EACH DRAWING WAS EXECUTED AT  
THE TIME THE CONTRACT WAS EXECUTED BY  
DATE **11/10/98** **Leslie E. Robertson**  
SPEC. WRITER  
ENGINEER OF RECORD

12/12/97 MODIFY F.O. TANK PIPES  
11/17/97 ISSUED FOR BID

No. Date Revision Approved  
Engineering Department  
Design Divisions

**The  
World  
Trade  
Center**

Title  
**STANDBY POWER  
5 WORLD TRADE CENTER**

**MECHANICAL**

**FUEL, OIL  
RISER DIAGRAM**


This drawing subject to conditions in contract.  
All inventions, ideas, designs and methods  
herein are reserved to Port Authority and  
may not be used without its written consent.

J.D. M.A.R.  
Designed by Drawn by Check by

Date 11/12/97 Scale NONE

Contract Number Drawing Number

**WTC-945-071 MT-03**

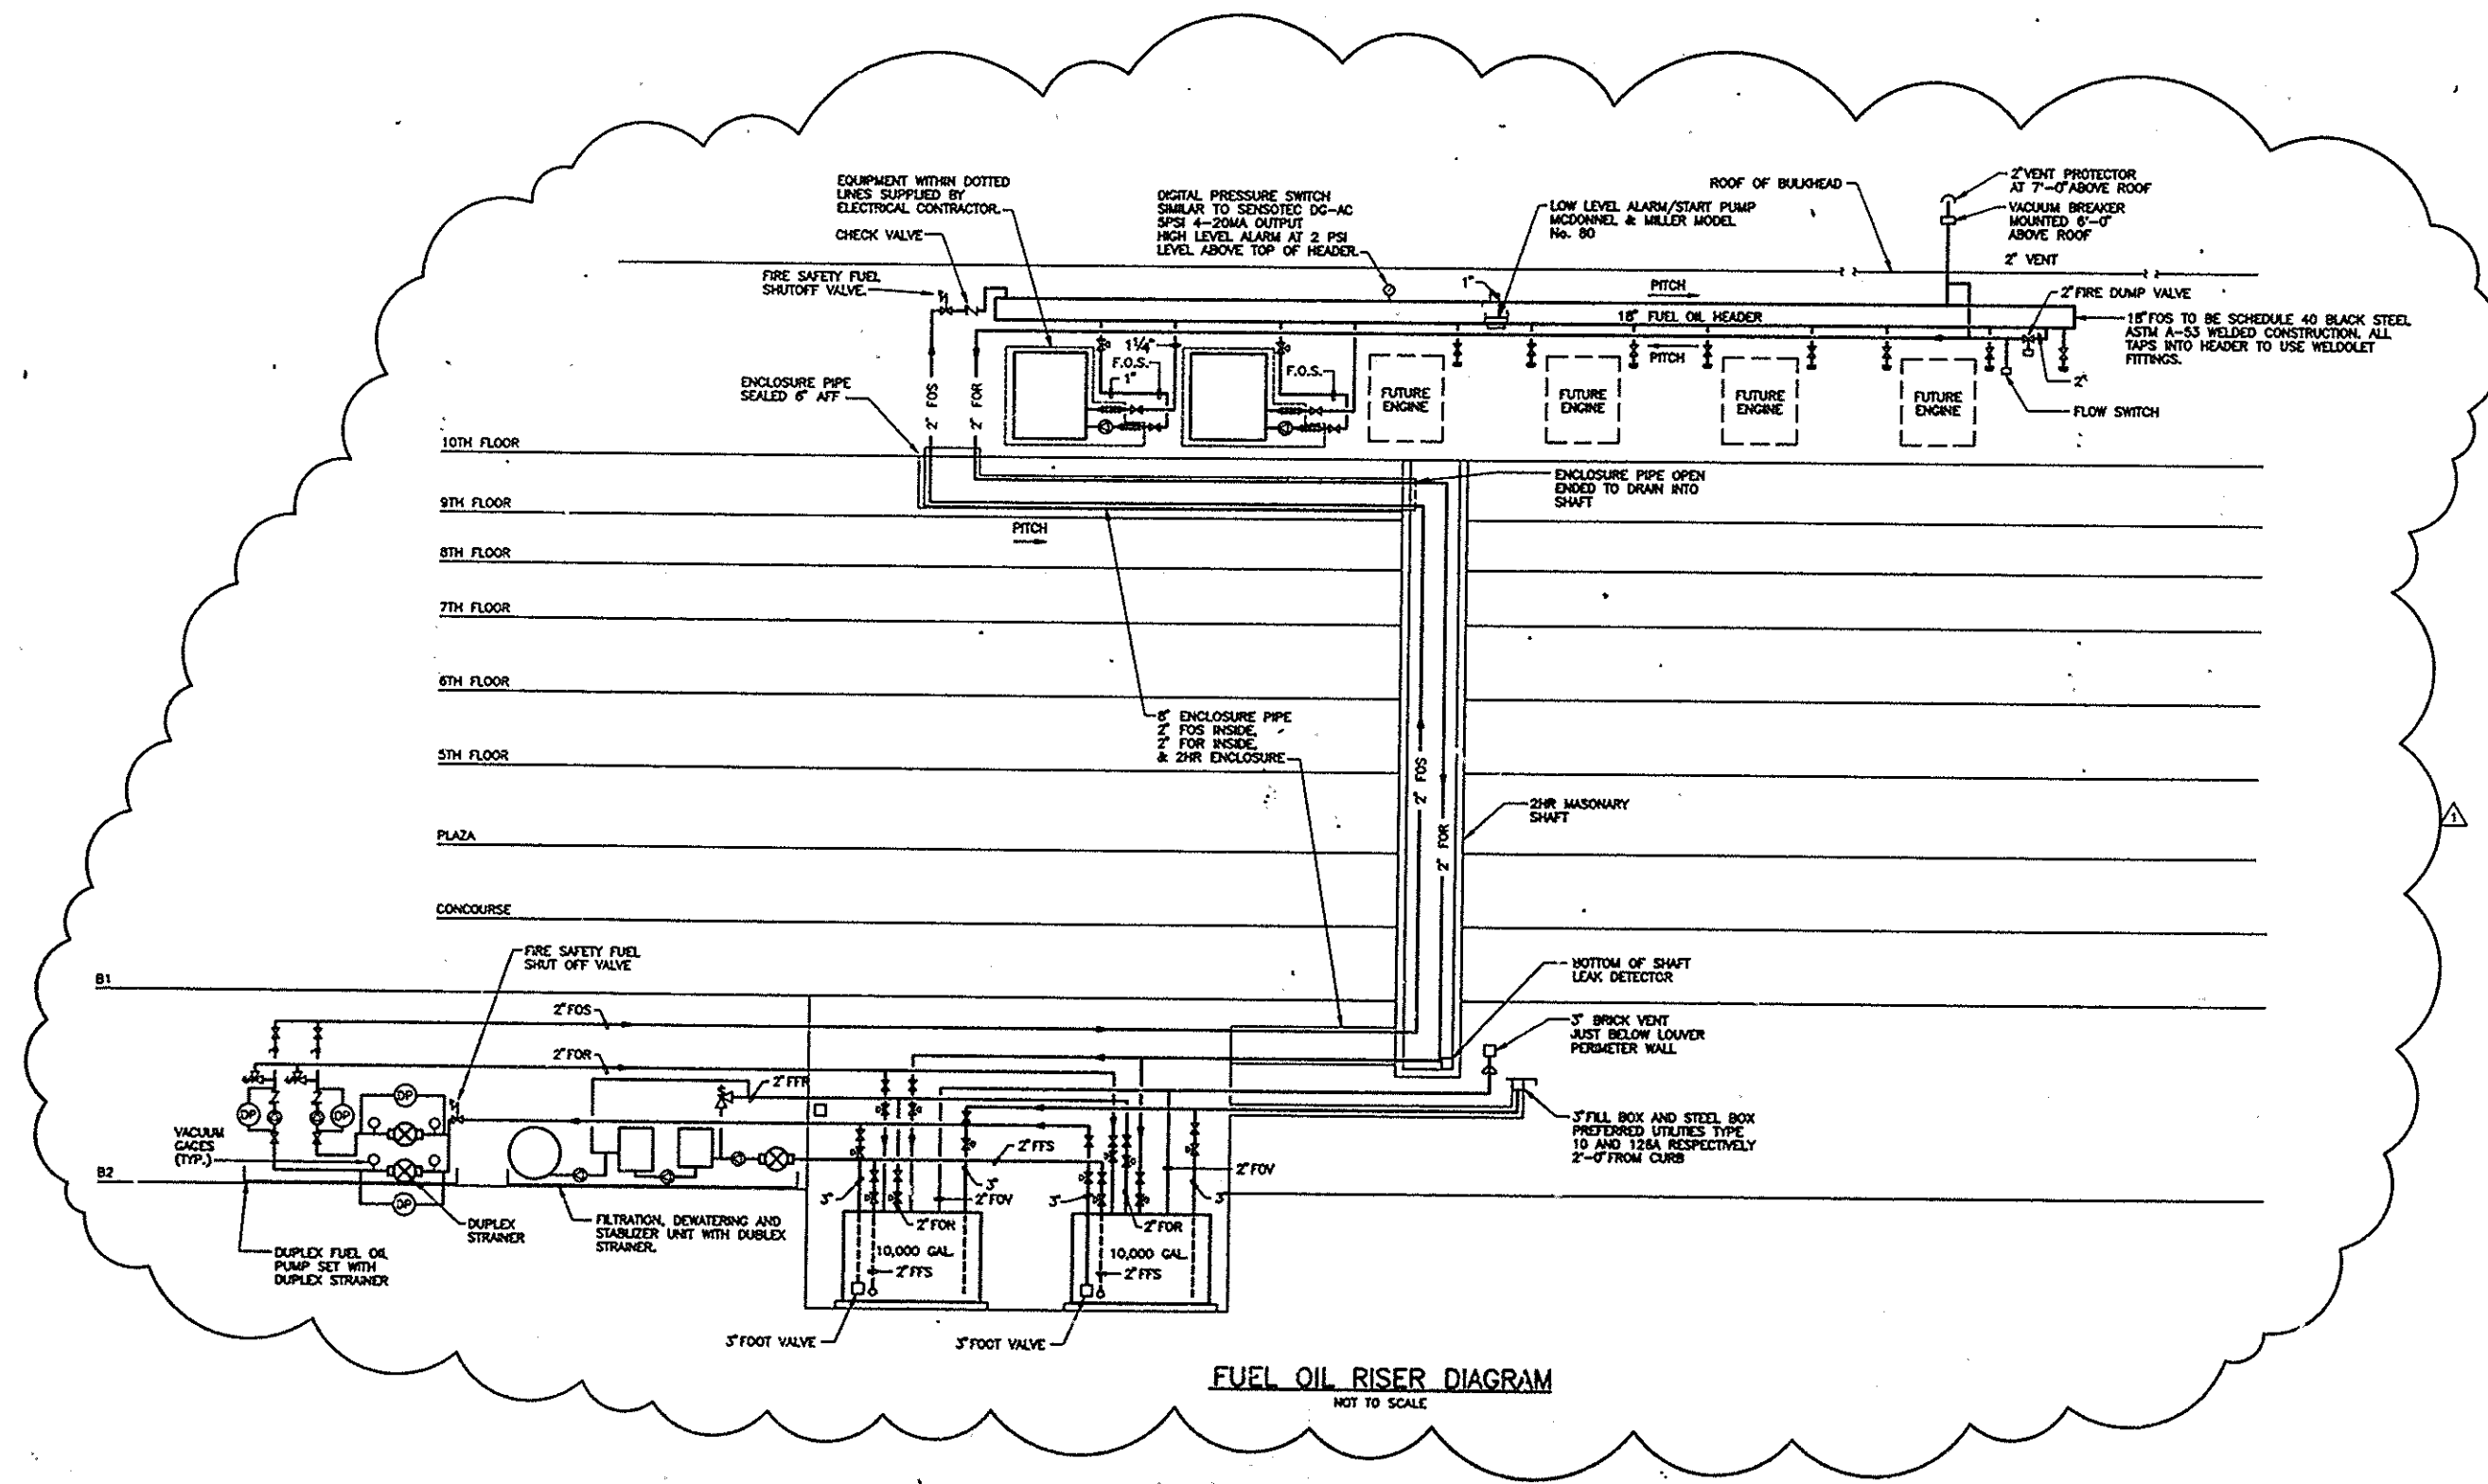

**FUEL OIL RISER DIAGRAM**  
NOT TO SCALE

